


1 HANDICAP RAMP

- NOTES:
- 4500 PSI STANDARD MIX CONCRETE WITH 3/4" STONE.
 - PROCESS GRAVEL UNDER SIDEWALK TO BE COMPACTED IN 6" LIFTS.
 - CONCRETE TO BE SPRAYED WITH HARRIS SUPER KURSEAL 830 OR EQUIVALENT.
 - SIDEWALK TO HAVE NON-SKID HAIR BROOM FINISH PERPENDICULAR TO CURB.

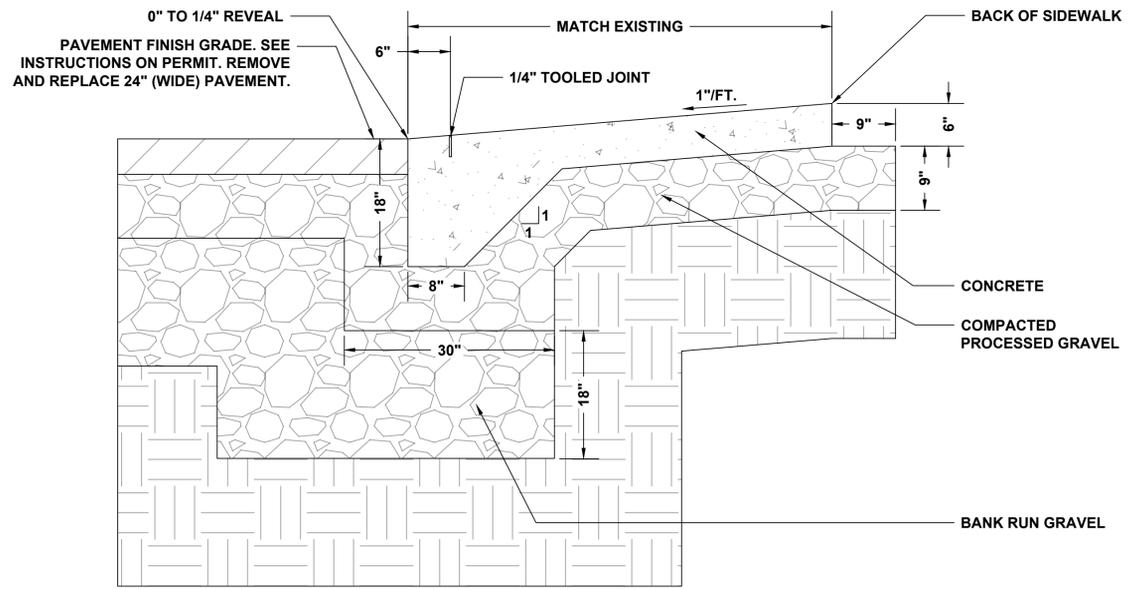

2 HANDICAP RAMP & CURB

CITY OF GROTON: APPROVED PLAN
 THE PLANS UPON WHICH THIS STAMP IS AFFIXED ARE APPROVED. ALL WORK MUST CONFORM TO THE REPRESENTATIONS MADE HEREIN AND ALL OTHER APPLICABLE DOCUMENTS OR CONDITIONS. IT IS THE APPLICANT'S RESPONSIBILITY TO SECURE ADDITIONAL PERMITS AS MAY BE REQUIRED. ANY MODIFICATIONS TO THESE PLANS REQUIRED IN ORDER TO SECURE OTHER PERMITS OR ADDRESS FIELD CONDITIONS DURING CONSTRUCTION MUST FIRST BE APPROVED BY THE CITY PLANNER OR PLANNING AND ZONING COMMISSION, AS MAY BE APPLICABLE, AND PRIOR TO COMMENCING WITH SAID IMPROVEMENTS.

CHAIRMAN _____ DATE _____

ISSUED FOR PERMIT	DESCRIPTION
0 8/6/2019	DATE
REV.	PROJECT NO.
	FILE NO.

TOWN OF GROTON
 PUBLIC WORKS DEPARTMENT
 ENGINEERING
 134 GROTON LONG POINT ROAD
 GROTON, CONNECTICUT 06340
 (860) 448-4066

SHENNECOSSETT CLUB HOUSE
 PAR 4 ENTRANCE SITE IMPROVEMENTS
 93 PLANT STREET, GROTON, CT 03640

DESIGNED BY: TRT	DATE: 8/6/2019
DRAWN BY: TRT	DATE: 8/6/2019
CHECKED BY:	DATE:
APPROVED BY:	DATE:
SCALE: 1" = 10'	
DATE: 8/6/2019	
PAGE NO.: 4 OF 4	